





Programa:

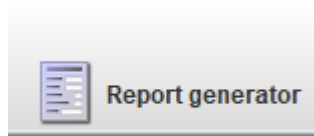


Power Vision Plus

### Eiga pažingsniui.

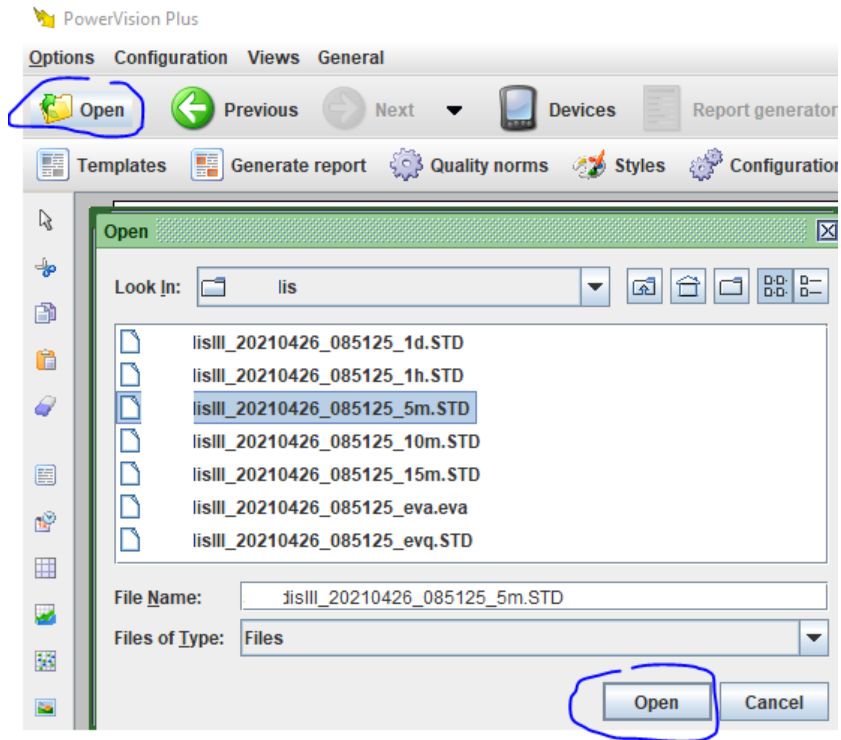

Load

Standartas 50160 ( naudojamas iš anksto išsaugotas ruošinys Standartas50160)

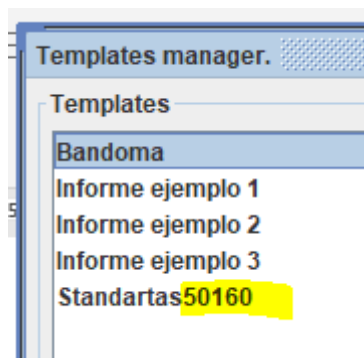

Turime paruoštą formą:

Text: **Voltage quality**

Text:

Basic filter:  
**OK / NOK**


Text:

Parameters filter:

Setup	V11	V12	V13
Base value	230	230	230
% values OK	95	95	95
% maximum relative to OK	10	10	10
% minimum relative to OK	10	10	10
Mark registers with events	Disable	Disable	Disable


Text:

Middle filter:  
- Show relative values of variables : Enable  
- Bar results :



Page break:

Text:



Pasirenkame įrenginį:

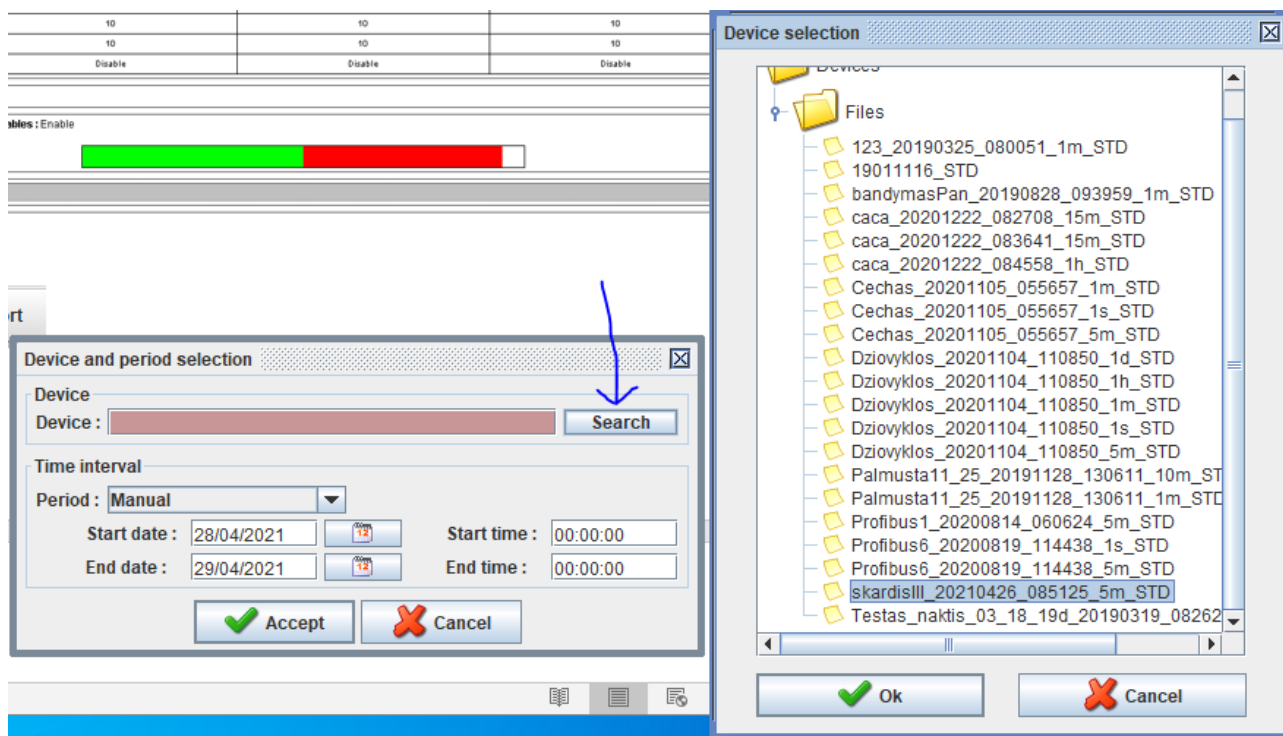



Table:

10	10	10
10	10	10
Disable	Disable	Disable

Text: Files : Enable



Device and period selection dialog:

Device:  
Device :  Search

Time interval:  
Period : Manual

Start date : 28/04/2021 Start time : 00:00:00  
End date : 29/04/2021 End time : 00:00:00

Accept Cancel

Device selection dialog:

Files

- 123\_20190325\_080051\_1m\_STD
- 19011116\_STD
- bandymasPan\_20190828\_093959\_1m\_STD
- caca\_20201222\_082708\_15m\_STD
- caca\_20201222\_083641\_15m\_STD
- caca\_20201222\_084558\_1h\_STD
- Cechas\_20201105\_055657\_1m\_STD
- Cechas\_20201105\_055657\_1s\_STD
- Cechas\_20201105\_055657\_5m\_STD
- Dziovyklos\_20201104\_110850\_1d\_STD
- Dziovyklos\_20201104\_110850\_1h\_STD
- Dziovyklos\_20201104\_110850\_1m\_STD
- Dziovyklos\_20201104\_110850\_1s\_STD
- Dziovyklos\_20201104\_110850\_5m\_STD
- Palmusta11\_25\_20191128\_130611\_10m\_STD
- Palmusta11\_25\_20191128\_130611\_1m\_STD
- Profibus1\_20200814\_060624\_5m\_STD
- Profibus6\_20200819\_114438\_1s\_STD
- Profibus6\_20200819\_114438\_5m\_STD
- skardisIII\_20210426\_085125\_5m\_STD
- Testas\_naktis\_03\_18\_19d\_20190319\_08262

Ok Cancel

OK

**Device and period selection**

Device: skardisIII\_20210426\_085125\_5m\_STD Search

Time interval

Period: Automatic

Start date: 17/04/2021 📅 Start time: 16:30:00

End date: 26/04/2021 📅 End time: 11:55:00

✔ Accept ✘ Cancel

Accept

**Progress window**

Progress:


Message:  
Variables table retrieved correctly.

History:  
Starting report generation.  
Starting request of values.  
Variables table retrieved correctly.  
Variables table retrieved correctly.  
Variables table retrieved correctly.  
Variables table retrieved correctly.  
Variables table retrieved correctly.  
Variables table retrieved correctly.

✔ Accept ✘ Cancel

Accept

Turime sugeneruotą ataskaitą:

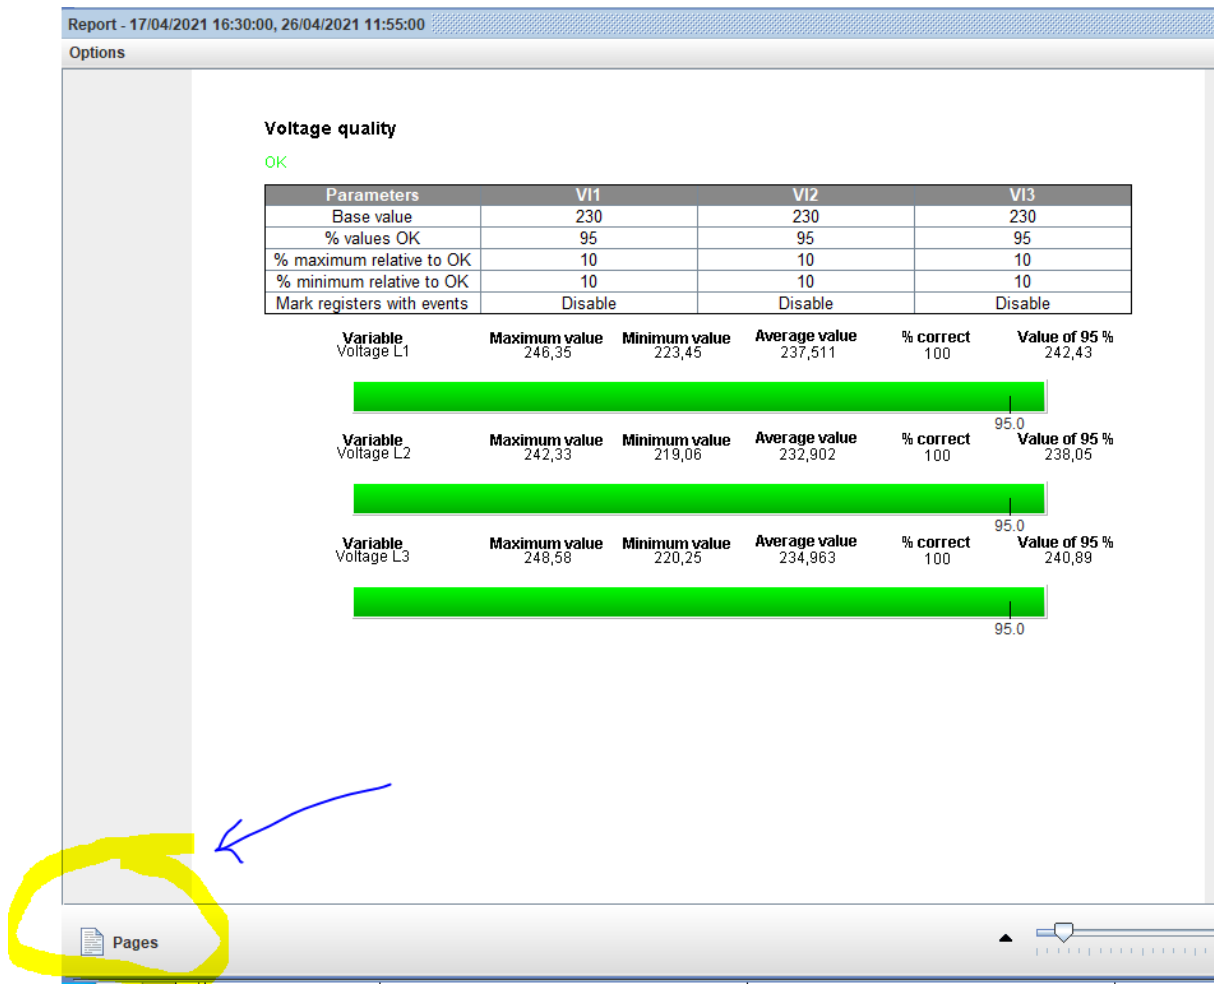

Vartome ataskaitos lapus „Pages“:

Pvz. ilgalaikiai pertrūkiai.

**Flicker Plt quality**

NOK

Parameters	Plt L1	Plt L2	Plt L3
Base value	1	1	1
% values OK	95	95	95
% maximum relative to OK	0	0	0
% minimum relative to OK	100	100	100
Mark registers with events	Disable	Disable	Disable

<b>Variable</b> Plt L1	<b>Maximum value</b> 1,88	<b>Minimum value</b> 0,938	<b>Average value</b> 1,037	<b>% correct</b> 12	<b>Value of 95 %</b> 1,078
---------------------------	------------------------------	-------------------------------	-------------------------------	------------------------	-------------------------------



<b>Variable</b> Plt L2	<b>Maximum value</b> 3,584	<b>Minimum value</b> 0,583	<b>Average value</b> 0,814	<b>% correct</b> 96	<b>Value of 95 %</b> 0,943
---------------------------	-------------------------------	-------------------------------	-------------------------------	------------------------	-------------------------------



<b>Variable</b> Plt L3	<b>Maximum value</b> 3,931	<b>Minimum value</b> 0,485	<b>Average value</b> 0,885	<b>% correct</b> 97	<b>Value of 95 %</b> 0,978
---------------------------	-------------------------------	-------------------------------	-------------------------------	------------------------	-------------------------------



Pvz. trumpalaikiai pertrūkiai.

**Flicker Pst quality**

NOK

Parameters	Pst L1	Pst L2	Pst L3
Base value	1	1	1
% values OK	95	95	95
% maximum relative to OK	0	0	0
% minimum relative to OK	100	100	100
Mark registers with events	Disable	Disable	Disable

<b>Variable</b> Pst L1	<b>Maximum value</b> 3,49	<b>Minimum value</b> 0,8	<b>Average value</b> 1,019	<b>% correct</b> 58	<b>Value of 95 %</b> 1,25
---------------------------	------------------------------	-----------------------------	-------------------------------	------------------------	------------------------------



<b>Variable</b> Pst L2	<b>Maximum value</b> 5,38	<b>Minimum value</b> 0,43	<b>Average value</b> 0,724	<b>% correct</b> 85	<b>Value of 95 %</b> 1,17
---------------------------	------------------------------	------------------------------	-------------------------------	------------------------	------------------------------



<b>Variable</b> Pst L3	<b>Maximum value</b> 5,68	<b>Minimum value</b> 0,25	<b>Average value</b> 0,709	<b>% correct</b> 83	<b>Value of 95 %</b> 1,49
---------------------------	------------------------------	------------------------------	-------------------------------	------------------------	------------------------------




Pvz. asimetrijos kokybė.

**Asymmetry quality**

**NOK**

Parameters	Ka V III
Base value	2
% values OK	95
% maximum relative to OK	0
% minimum relative to OK	100
Mark registers with events	Disable

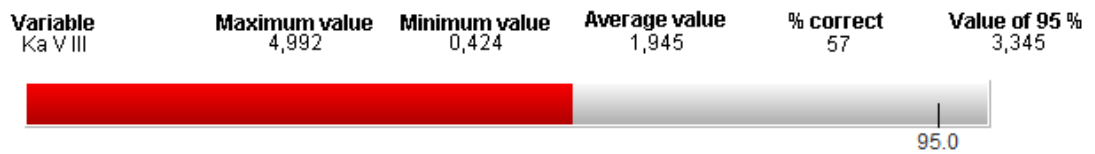

Pvz. harmonikų lygis.

